




SERAPHIC
STUDIO

Jewel Case Insert

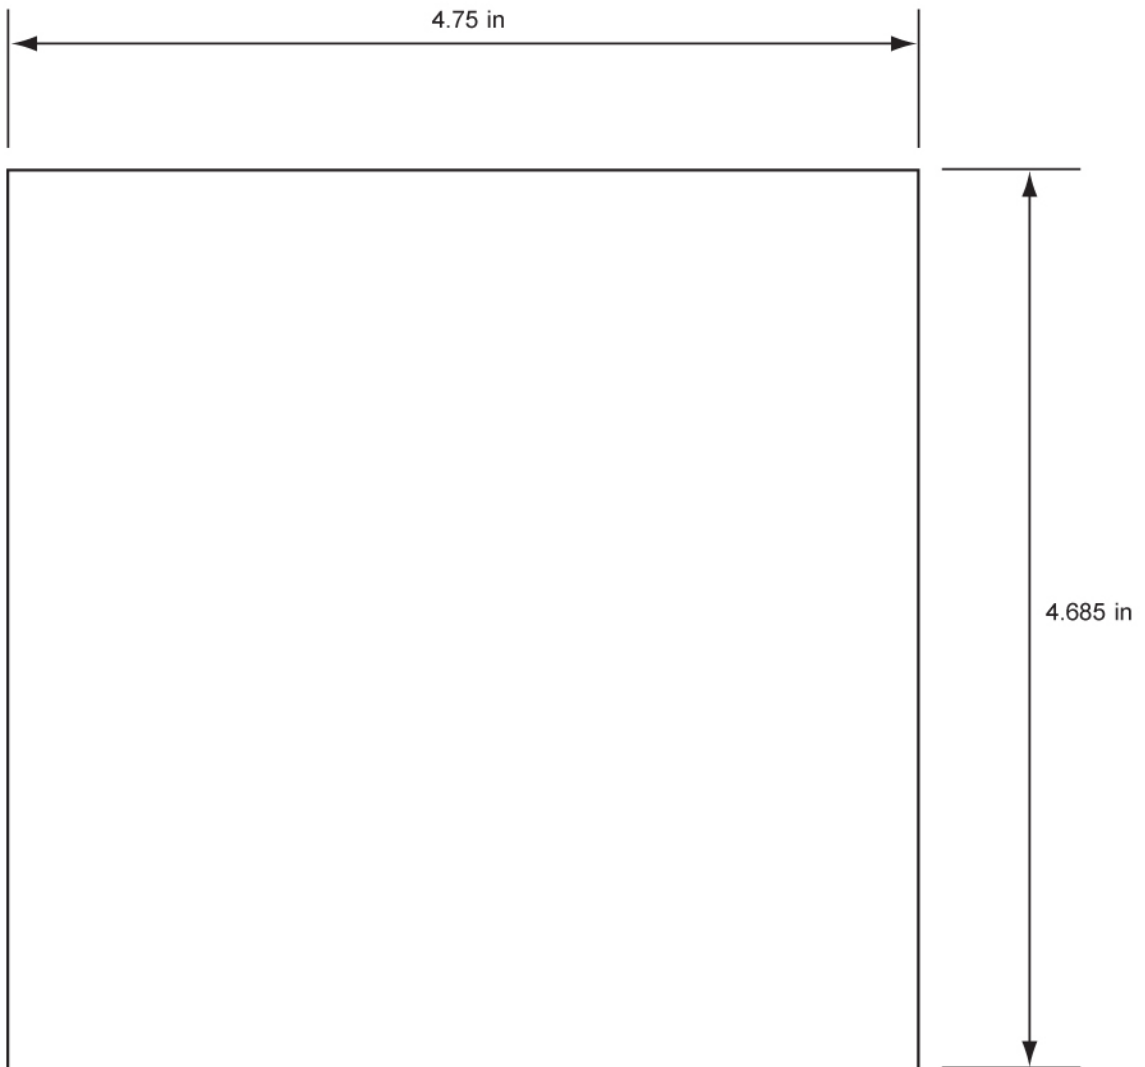

Bleeds should extend a minimum of 1/8" on all four sides